

PWCSA Hydrant Flow Report

General Information


Location:	17505 Mine Road	Date:	2-12-2020
Service Level:	Dumfries / Triangle	Time:	10:20 a.m.
High/Low HGL:	299 / 279	Test By:	TR/JL

Static Hydrant Information

Map Number:	428	Static Hydrant Number:	11
Manufacturer:	Mueller	Static Pressure:	74 psi
Year Manufactured:	2000	Residual Pressure:	58 psi

Flow Hydrant Information

Map Number:	428	Flow Hydrant Number:	1
Manufacturer:	Mueller	Flow Rate:	1000 gpm
Year Manufactured:	2001	Pitot Pressure:	35 psi

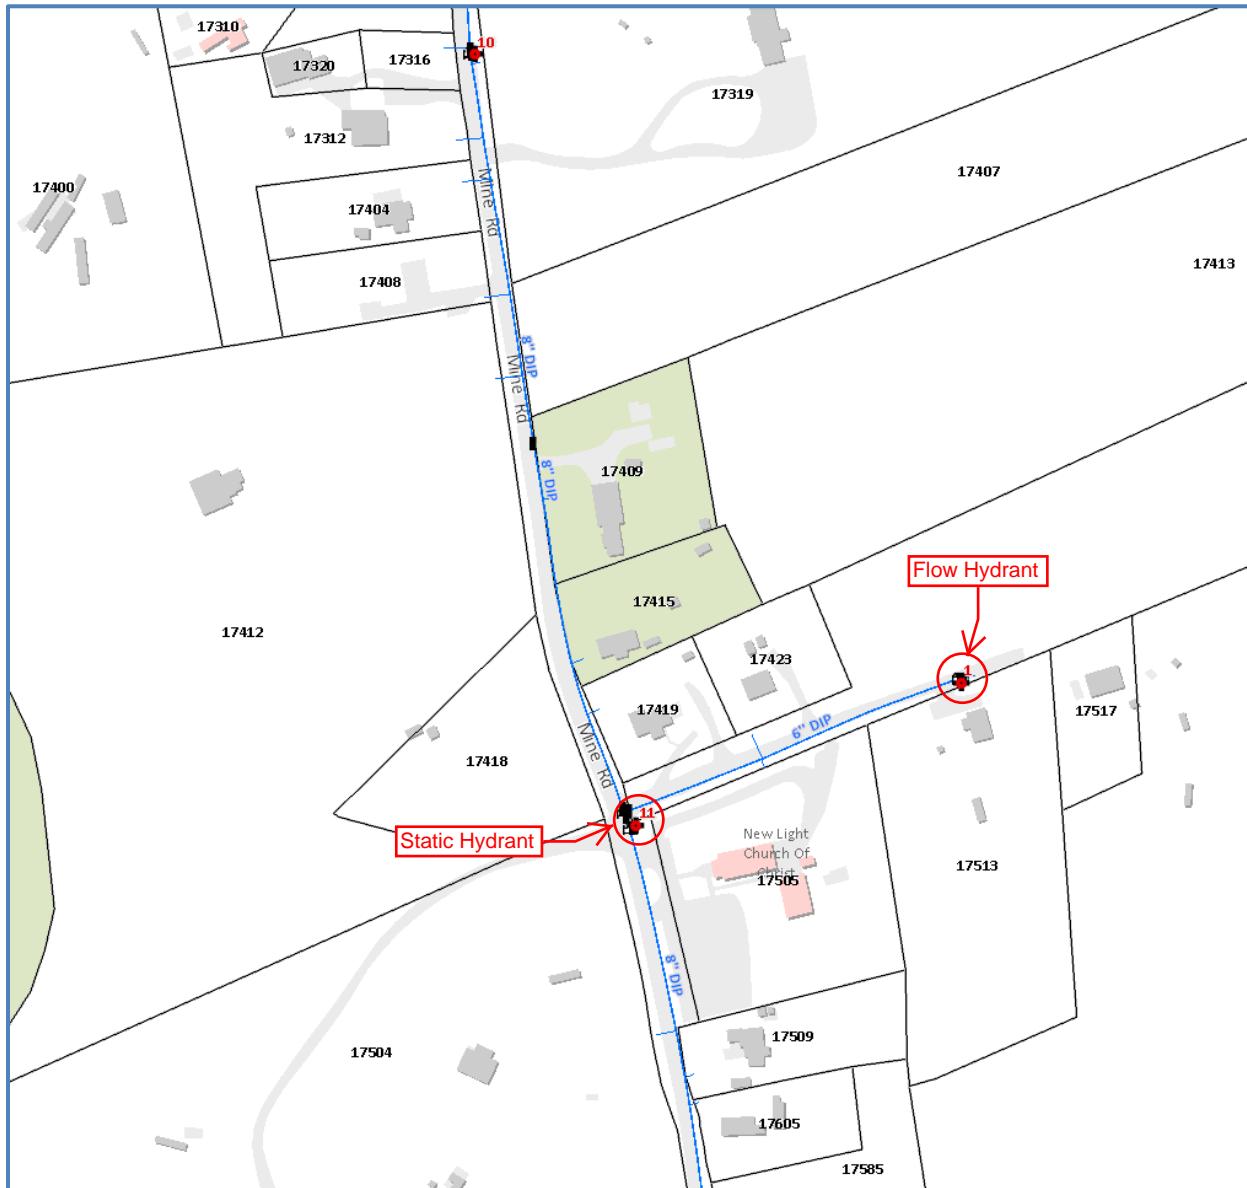

** The Prince William County Service Authority is not responsible for assumptions, calculations, or designs made based on the results of this test. Please note that the flows available from these hydrants are subject to changes or operational variations in the PWCSA's water system. You are requested to apply these results exercising professional judgment and employing the help of an accurate hydraulic computer model**

Report generated on: February 12, 2020