

PWCSA Hydrant Flow Report

General Information


Location:	2645 Prince William Pkwy / 14030 Telegraph Rd	Date:	9-11-2018
Service Level:	Lake Ridge	Time:	11:05 a.m.
High/Low HGL:	391 / 371	Test By:	TR/TH

Static Hydrant Information

Map Number:	312	Static Hydrant Number:	117
Manufacturer:	Kennedy	Static Pressure:	71 psi
Year Manufactured:	2002	Residual Pressure:	68 psi

Flow Hydrant Information

Map Number:	312	Flow Hydrant Number:	168
Manufacturer:	Mueller	Flow Rate:	1250 gpm
Year Manufactured:	2015	Pitot Pressure:	55 psi

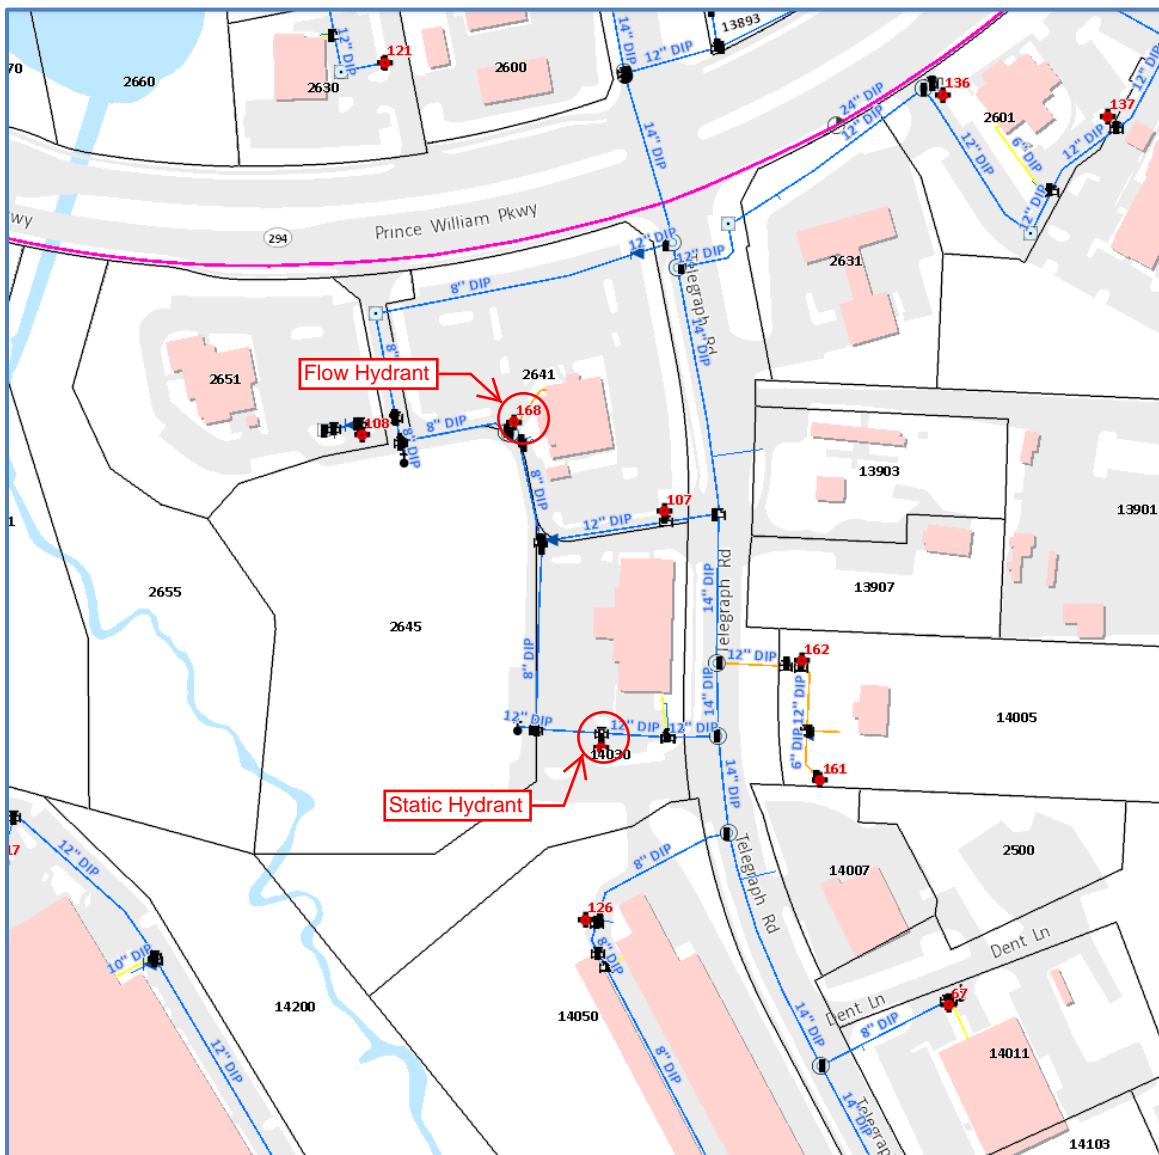

** The Prince William County Service Authority is not responsible for assumptions, calculations, or designs made based on the results of this test. Please note that the flows available from these hydrants are subject to changes or operational variations in the PWCSA's water system. You are requested to apply these results exercising professional judgment and employing the help of an accurate hydraulic computer model**

Report generated on: September 11, 2018