

# PWCSA Fire Flow Report

## General Information


Location:	9700 Innovation Dr – University Blvd Entrance	Date:	12-28-2016
Service Level:	Gainesville / Wellington	Time:	12:00 p.m.
High/Low HGL:	457 / 437	Test By:	KS/KC

## Static Hydrant Information

Map Number:	160	Static Hydrant Number:	5
Manufacturer:	Mueller	Static Pressure:	97 psi
Year Manufactured:	1996	Residual Pressure:	93 psi

## Flow Hydrant Information

Map Number:	160	Flow Hydrant Number:	4
Manufacturer:	Mueller	Flow Rate:	1620 gpm
Year Manufactured:	1996	Pitot Pressure:	93 psi

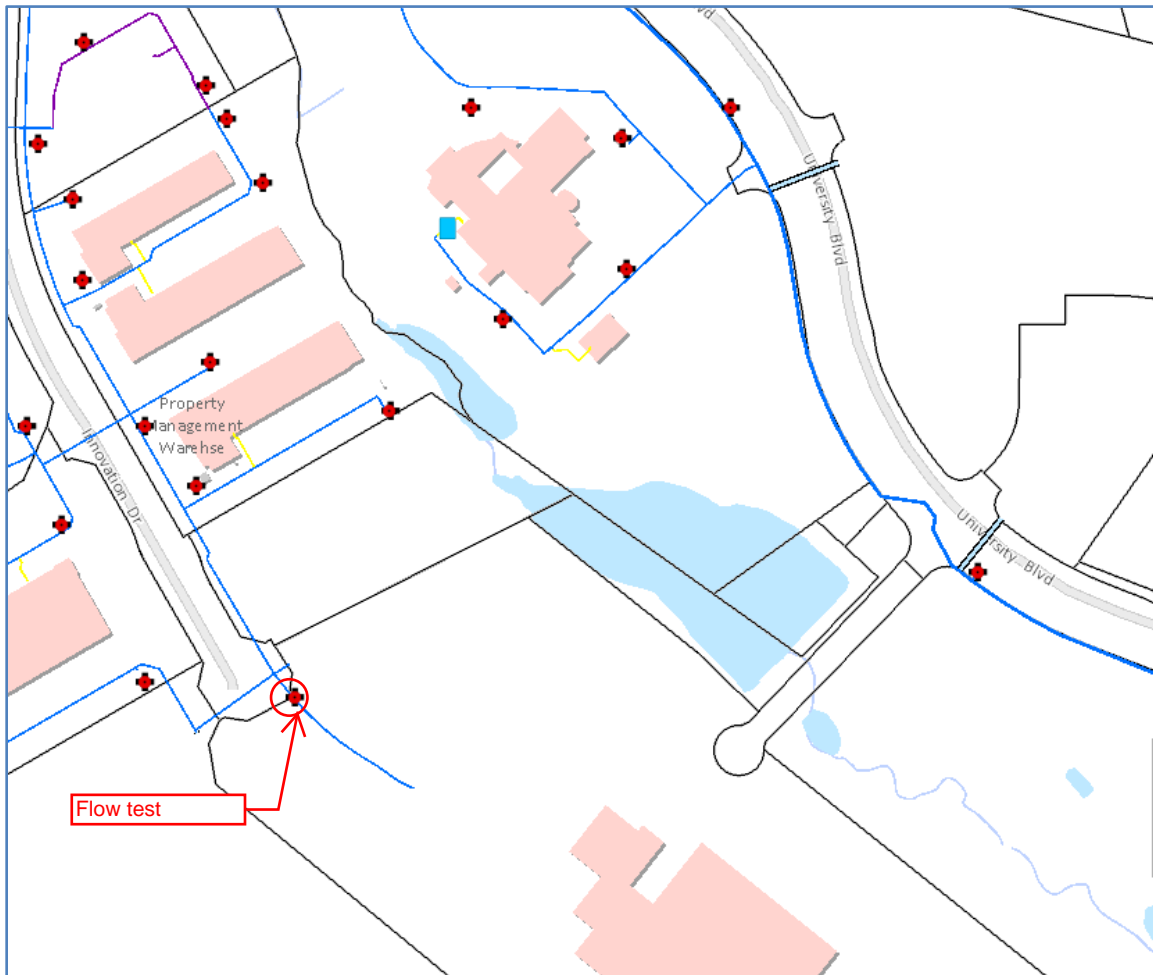

\*\* The Prince William County Service Authority is not responsible for assumptions, calculations, or designs made based on the results of this test. Please note that the flows available from these hydrants are subject to changes or operational variations in the PWCSA's water system. You are requested to apply these results exercising professional judgment and employing the help of an accurate hydraulic computer model\*\*

Report generated on: December 28, 2016