

# PWCSA Hydrant Flow Report

## General Information


Location:	Discovery Boulevard	Date:	7-22-2019
Service Level:	Gainesville / Wellington	Time:	12:30 p.m.
High/Low HGL:	457 / 437	Test By:	TR/JL

## Static Hydrant Information

Map Number:	159	Static Hydrant Number:	27
Manufacturer:	Kennedy	Static Pressure:	115 psi
Year Manufactured:	2004	Residual Pressure:	110 psi

## Flow Hydrant Information

Map Number:	159	Flow Hydrant Number:	28
Manufacturer:	Kennedy	Flow Rate:	1660 gpm
Year Manufactured:	2005	Pitot Pressure:	98 psi

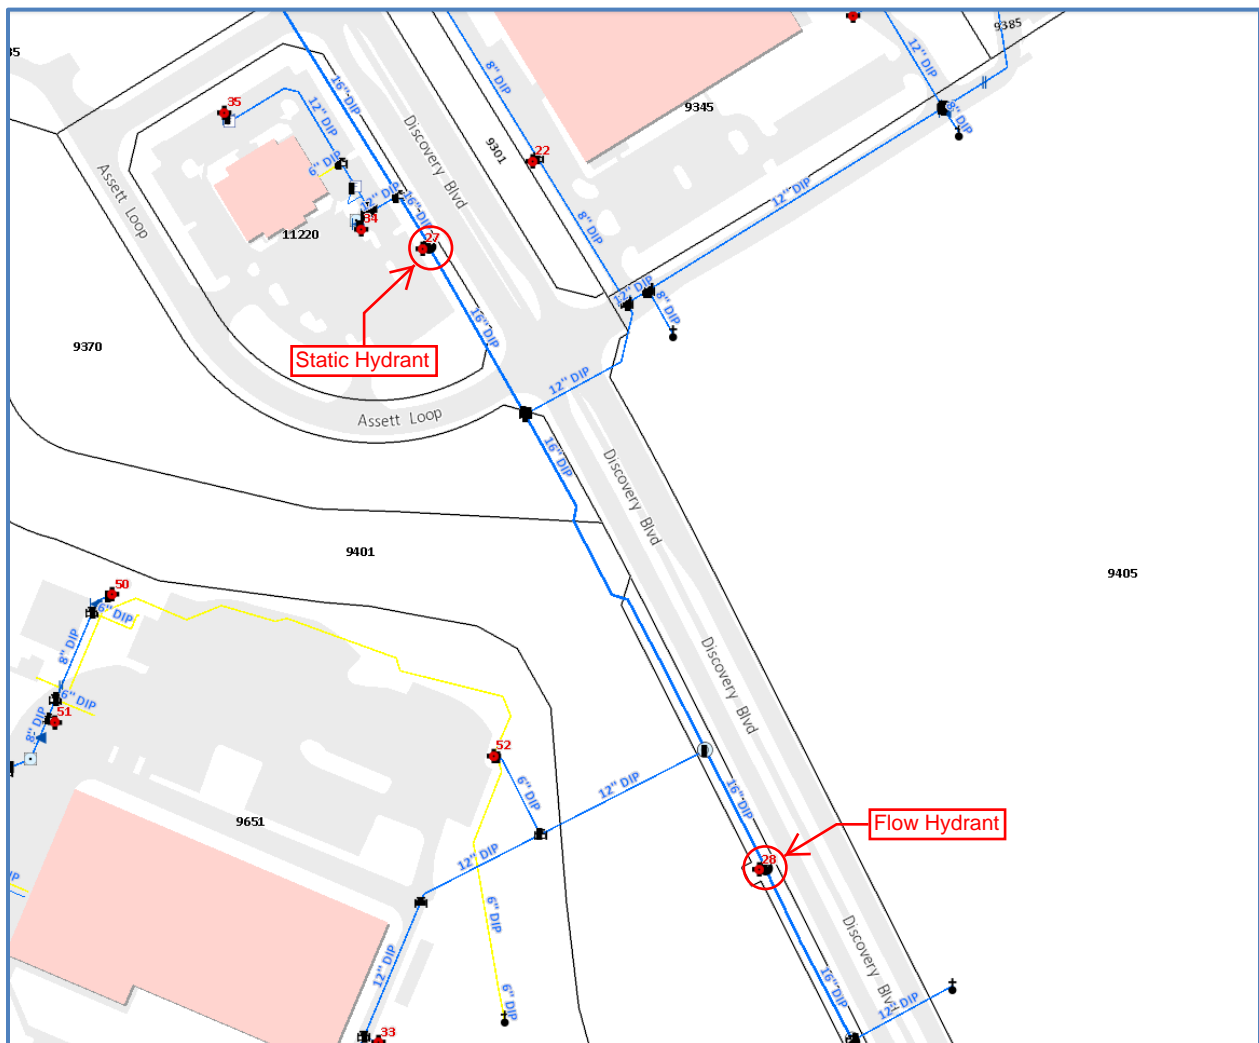

\*\* The Prince William County Service Authority is not responsible for assumptions, calculations, or designs made based on the results of this test. Please note that the flows available from these hydrants are subject to changes or operational variations in the PWCSA's water system. You are requested to apply these results exercising professional judgment and employing the help of an accurate hydraulic computer model\*\*

Report generated on: July 22, 2019