

PWCSA Hydrant Flow Report

General Information


Location:	John Marshall Highway (West of Haymarket)	Date:	7-2-2018
Service Level:	Haymarket	Time:	10:10 a.m.
High/Low HGL:	535 / 515	Test By:	JR/DH

Static Hydrant Information

Map Number:	078	Static Hydrant Number:	11
Manufacturer:	Mueller	Static Pressure:	67 psi
Year Manufactured:	1998	Residual Pressure:	62 psi

Flow Hydrant Information

Map Number:	078	Flow Hydrant Number:	12
Manufacturer:	Mueller	Flow Rate:	1160 gpm
Year Manufactured:	1998	Pitot Pressure:	47 psi

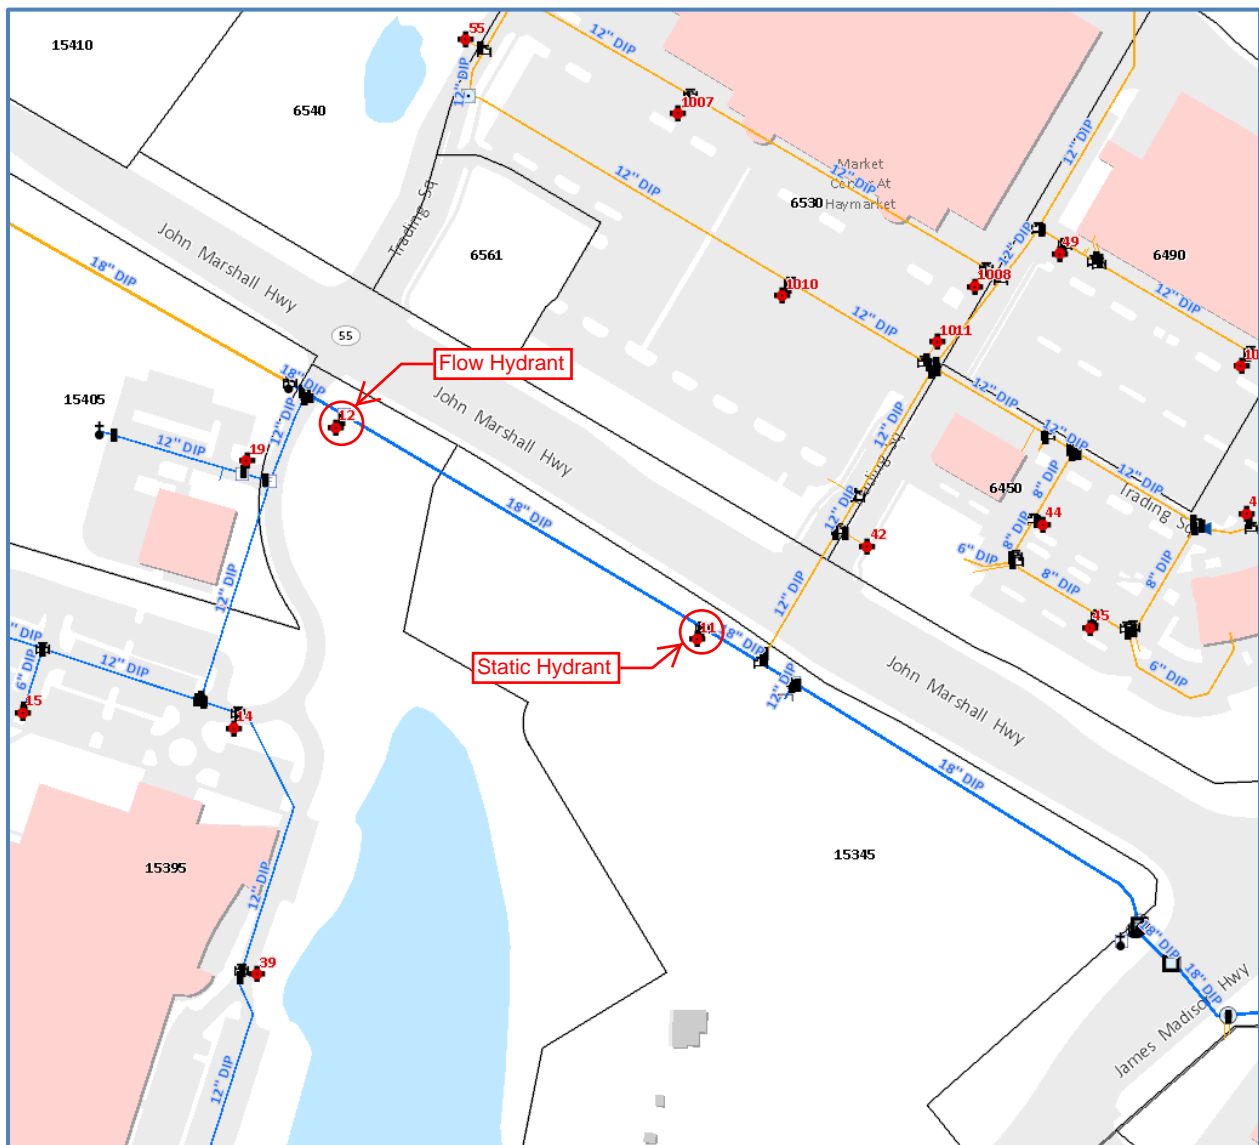

** The Prince William County Service Authority is not responsible for assumptions, calculations, or designs made based on the results of this test. Please note that the flows available from these hydrants are subject to changes or operational variations in the PWCSA's water system. You are requested to apply these results exercising professional judgment and employing the help of an accurate hydraulic computer model**

Report generated on: July 2, 2018