

# PWCSA Fire Flow Report

## General Information


Location:	Potomac River Blvd & Silver Arrow Dr	Date:	9-26-2016
Service Level:	Dumfries / Triange	Time:	10:40 a.m.
High/Low HGL:	299 / 279	Test By:	TH/TR

## Static Hydrant Information

Map Number:	416	Static Hydrant Number:	7
Manufacturer:	Mueller	Static Pressure:	90 psi
Year Manufactured:	2013	Residual Pressure:	89 psi

## Flow Hydrant Information

Map Number:	416	Flow Hydrant Number:	1003
Manufacturer:	Mueller	Flow Rate:	1405 gpm
Year Manufactured:	2012	Pitot Pressure:	70 psi

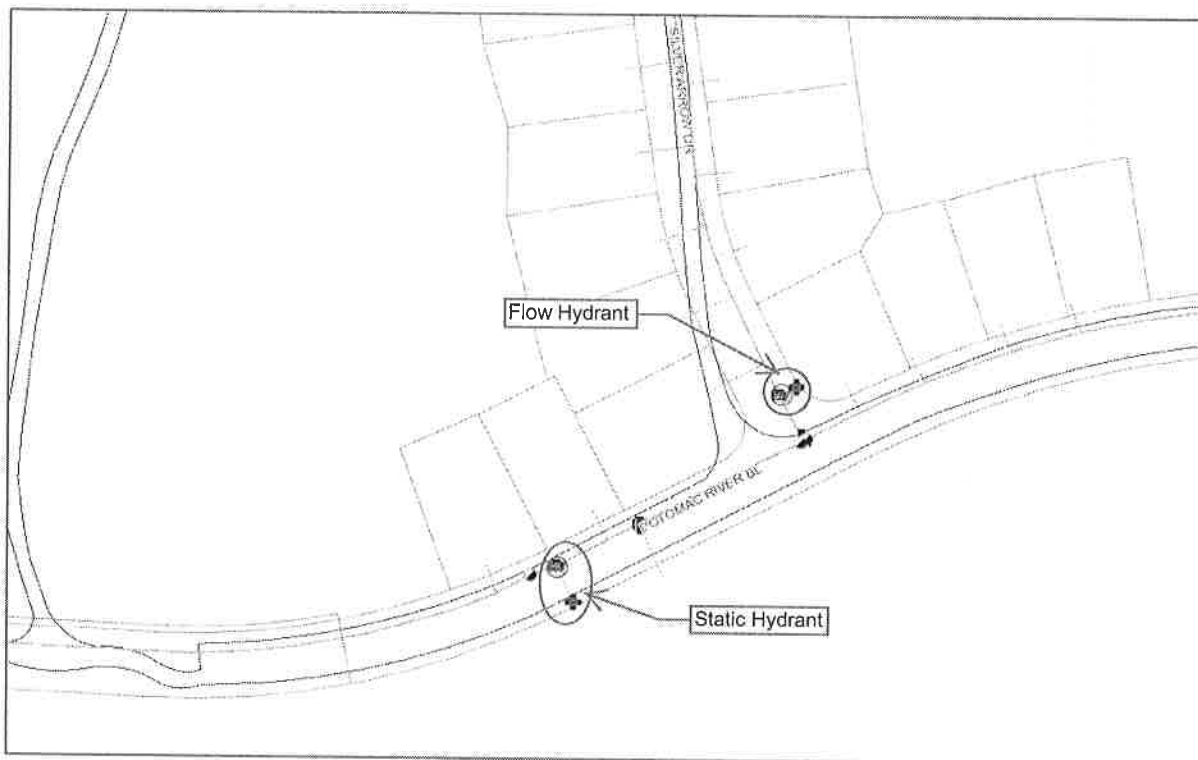

\*\* The Prince William County Service Authority is not responsible for assumptions, calculations, or designs made based on the results of this test. Please note that the flows available from these hydrants are subject to changes or operational variations in the PWCSA's water system. You are requested to apply these results exercising professional judgment and employing the help of an accurate hydraulic computer model\*\*

Report generated on: September 26, 2016