

PWCSA Hydrant Flow Report

General Information


Location:	11994 Livingston Rd	Date:	3-6-2018
Service Level:	Gainesville / Wellington	Time:	1:45 p.m.
High/Low HGL:	457 / 437	Test By:	TR/KC

Static Hydrant Information

Map Number:	112	Static Hydrant Number:	24
Manufacturer:	Mueller	Static Pressure:	80 psi
Year Manufactured:	2004	Residual Pressure:	77 psi

Flow Hydrant Information

Map Number:	112	Flow Hydrant Number:	50
Manufacturer:	Mueller	Flow Rate:	1300 gpm
Year Manufactured:	2004	Pitot Pressure:	60 psi

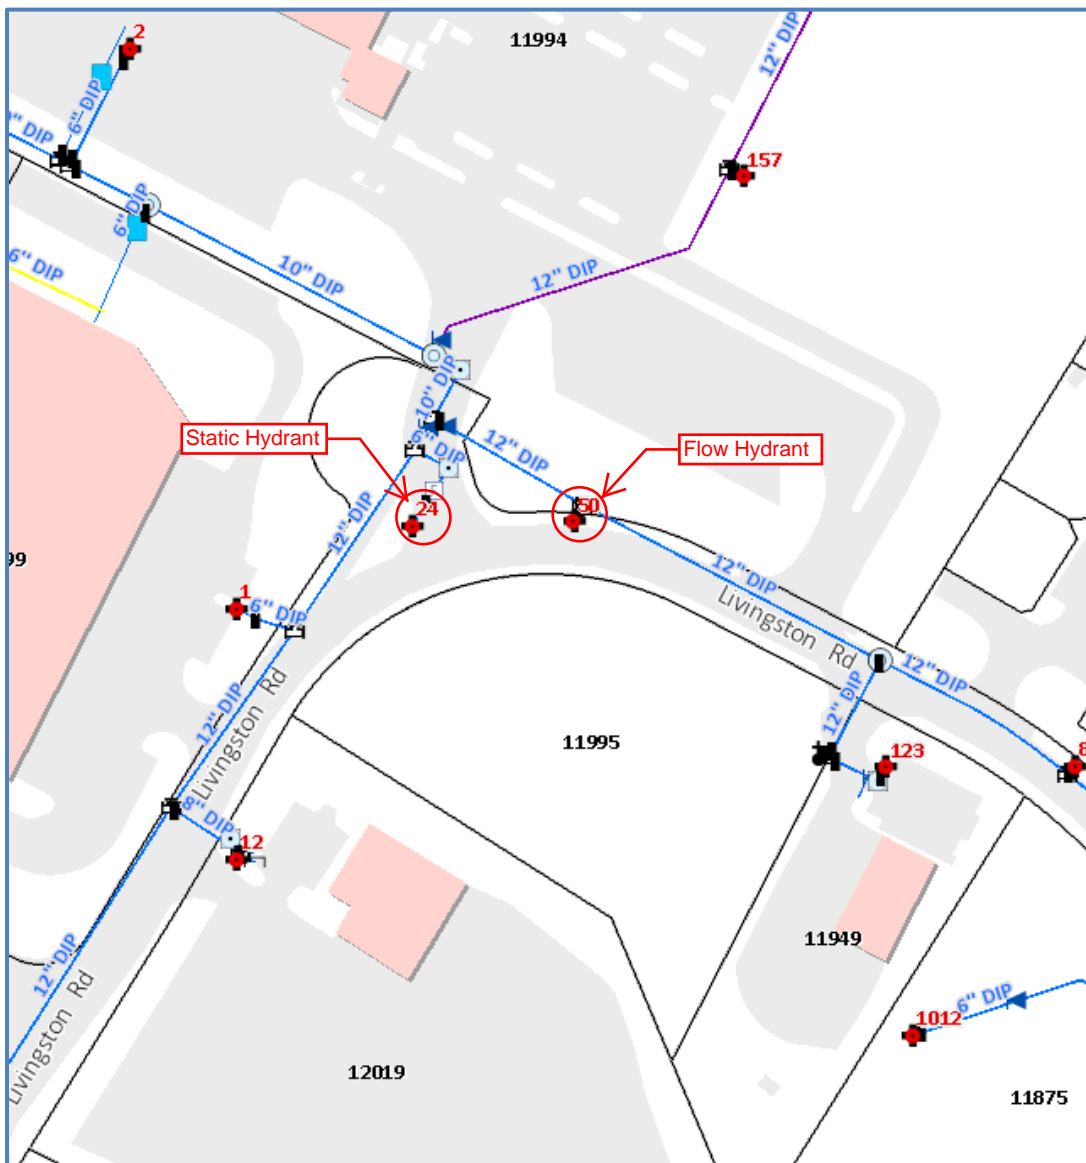

** The Prince William County Service Authority is not responsible for assumptions, calculations, or designs made based on the results of this test. Please note that the flows available from these hydrants are subject to changes or operational variations in the PWCSA's water system. You are requested to apply these results exercising professional judgment and employing the help of an accurate hydraulic computer model**

Report generated on: March 6, 2018