

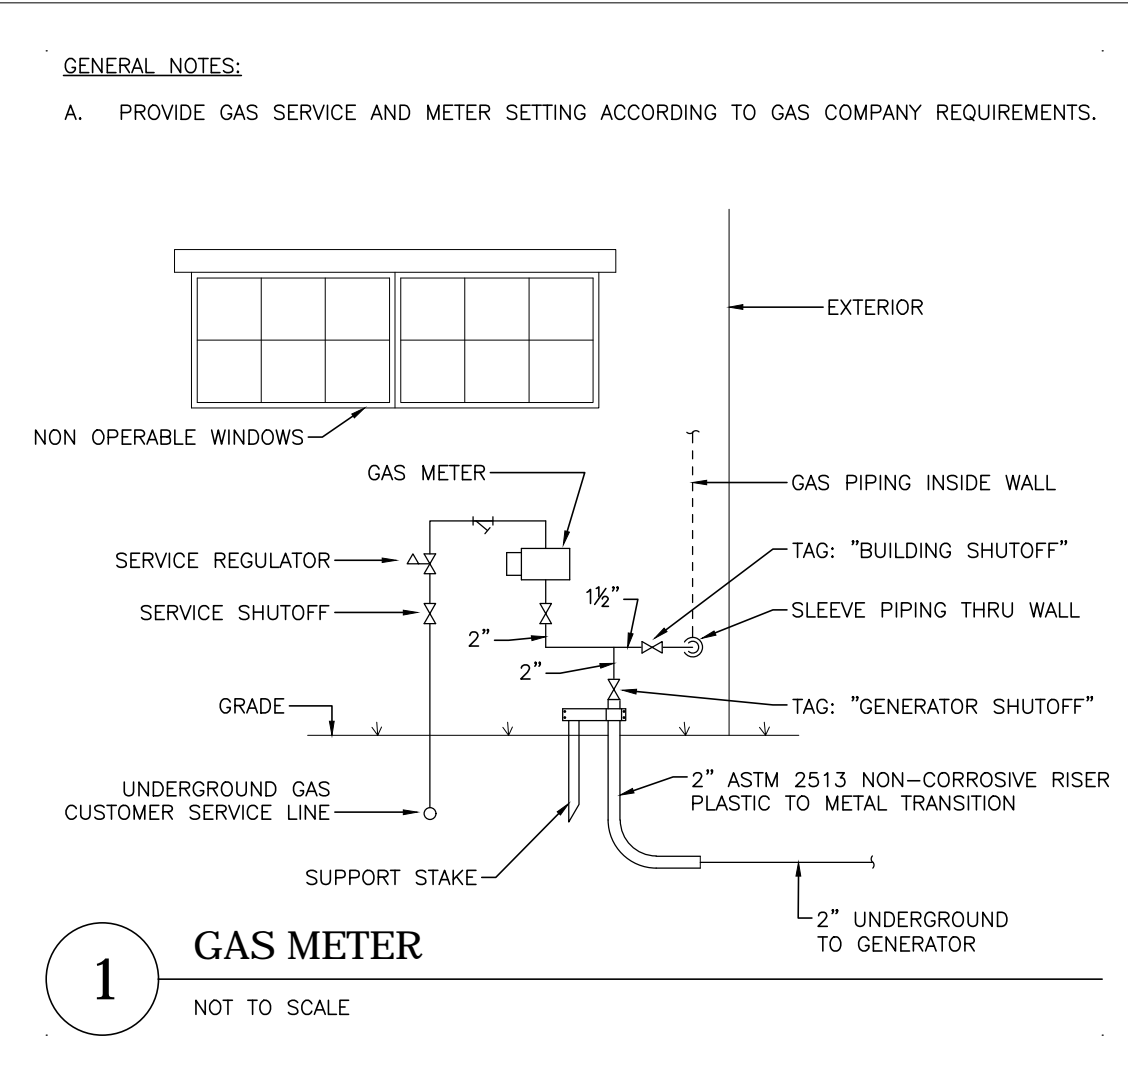
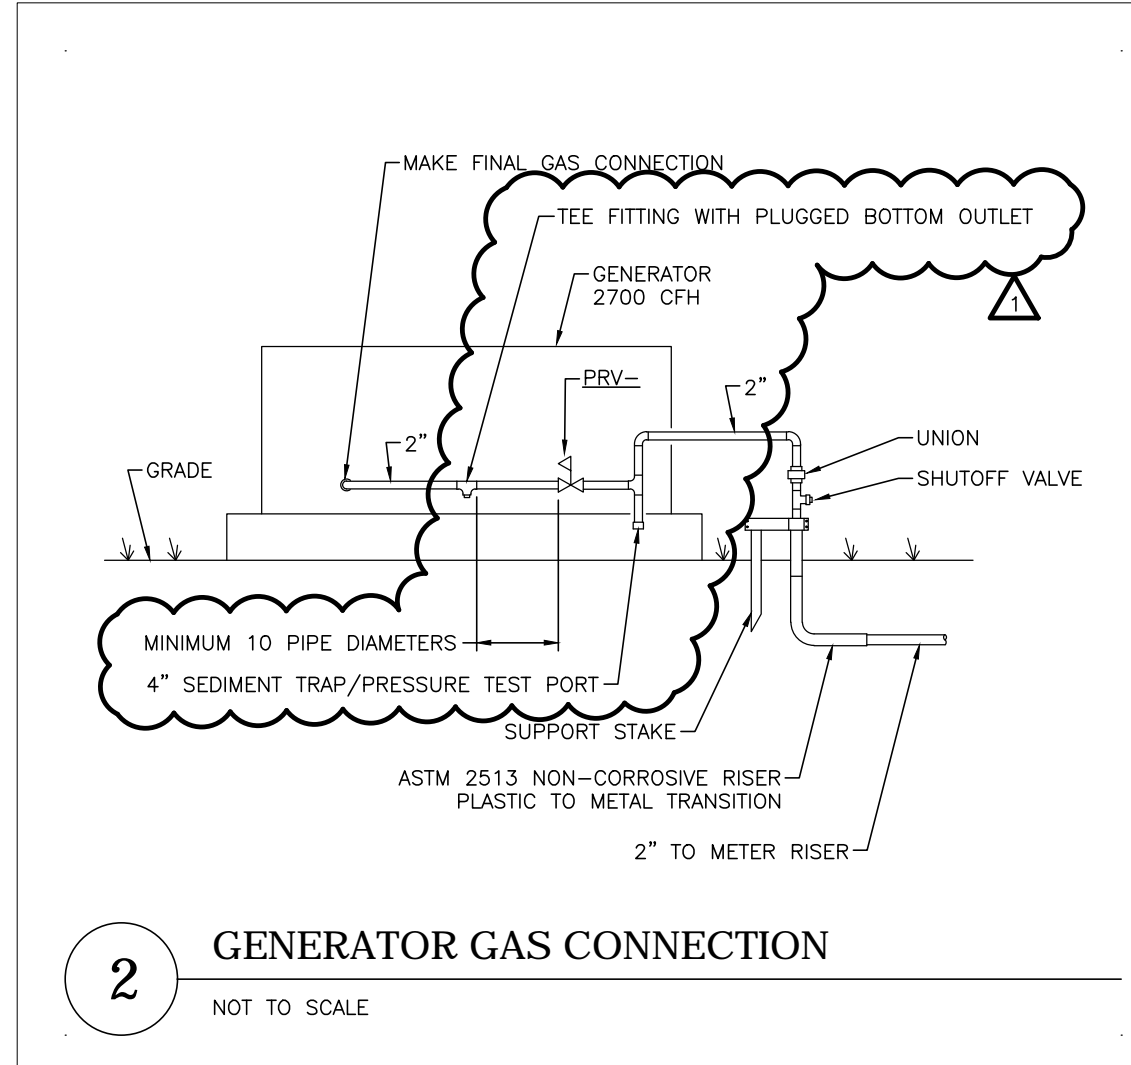


**SITE UTILITY PLAN**  
SCALE: 1"=20'-0"

- PLAN NOTES**
- E1. NEW PAD MOUNT UTILITY TRANSFORMER. E.C. TO PROVIDE CONCRETE PAD PER UTILITY COMPANY REQUIREMENTS.
  - E2. UTILITY COMPANY PRIMARY CABLES. E.C. TO PROVIDE (2) 5" CONDUITS AND ALL TRENCHING & BACKFILL. COORDINATE PICK-UP POINT AT STREET WITH UTILITY COMPANY.
  - E3. COORDINATE PICK-UP POINT AT STREET WITH UTILITY COMPANY.
  - E4. SECONDARY UNDERGROUND FEEDERS. SEE ONE LINE POWER RISER FOR ADDITIONAL INFORMATION. CONDUITS TO BE CONCRETE ENCASED UNDER PAVED AREAS. ALL TRENCHING & BACKFILL BY E.C.
  - E5. STUB SERVICE FEEDER CONDUITS AND CONDUCTORS INTO MAIN DISTRIBUTION SWITCHBOARD MSP.
  - E6. PROVIDE (3) 4" UNDERGROUND CONDUITS WITH PULL STRING FOR COMMUNICATIONS CABLING. COORDINATE PICK-UP POINT AT STREET WITH LOCAL UTILITIES.
  - E7. STUB CONDUITS @ 6" A.F.F. AT COMMUNICATIONS TERMINAL BOARD. SEE SHEET E2.2 FIRST FLOOR POWER PLAN FOR ADDITIONAL INFORMATION.
  - E8. COORDINATE WITH OTHER TRADES PRIOR TO INSTALLATION. CONTROL THRU LIGHTING CONTROL PANEL "LCP", LOCATED IN MAIN ELECTRICAL ROOM.
  - E9. UNDERGROUND FEEDER FOR GENERATOR. SEE RISER DIAGRAM FOR MORE INFORMATION.
  - F10. NATURAL GAS EMERGENCY GENERATOR. PROVIDE 200V-240V WITH CONCRETE PAD.
  - E11. PROVIDE (2) #6, (1) #10 GRID IN 1" CONDUIT UNDERGROUND FEEDER FOR FUTURE PANEL IN SHEED. STUB UP CONDUITS 8" ABOVE FINISHED FLOOR. FIELD COORDINATE LOCATION OF PANEL PRIOR TO INSTALLATION. PROVIDE 60A, 240/120V-1P LOAD CENTER IN NEW 30' ENCLOSURE.
  - E12. COORDINATE EXACT LOCATION OF SIGN PRIOR TO INSTALLATION.
  - E13. POWER FOR FLAG LIGHT BY OTHERS. PROVIDE POWER AND UNDERGROUND PULL BOX IN FLAG POLE LOCATION. COORDINATE EXACT LOCATION WITH ARCHITECT AND OWNER PRIOR TO INSTALLATION.
  - P1. NEW GAS CUSTOMER SERVICE LINE. INSTALLATION BY GAS COMPANY. MAKE ARRANGEMENTS FOR NEW SERVICE AND COORDINATE REQUIREMENTS WITH GAS COMPANY.
  - P2. NEW GAS METER WITH CAPACITY AS INDICATED.
  - P3. GAS PIPING INTO BUILDING.
  - P4. UNDERGROUND GAS PIPING TO GENERATOR. COORDINATE ROUTING WITH SITE UTILITIES. SEE CIVIL DRAWINGS AND COORDINATE WITH SITE CONTRACTOR.
  - P5. GAS CONNECTION TO GENERATOR.

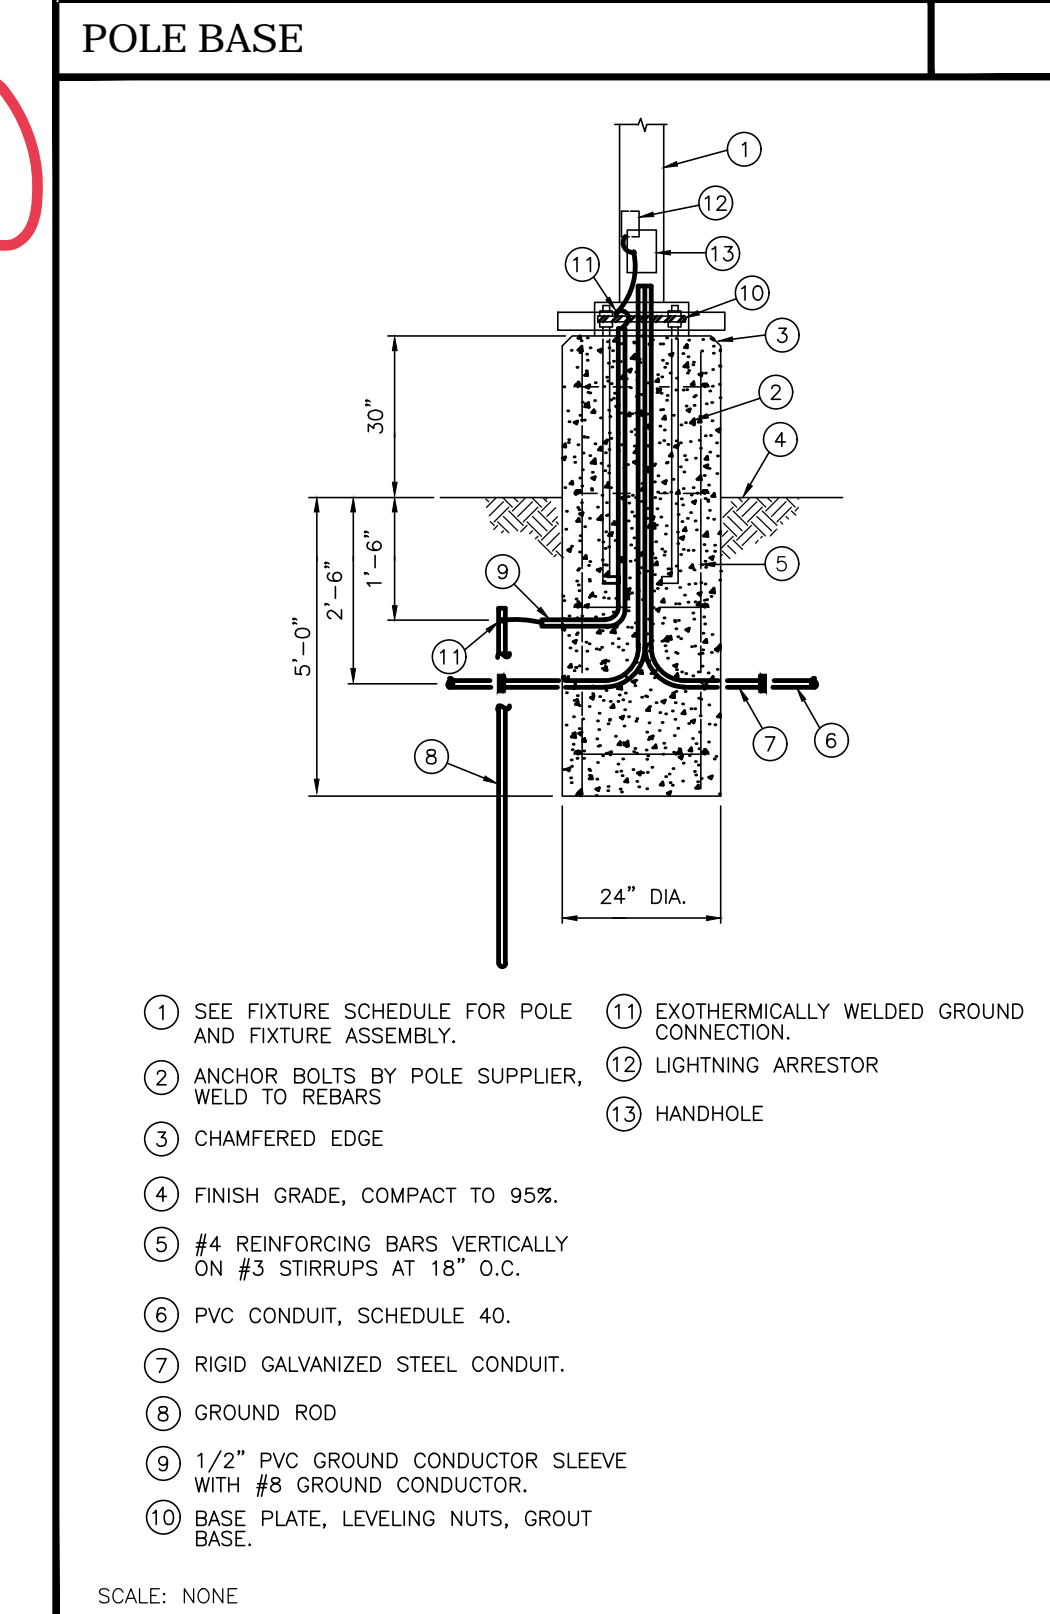

775 Yard Street, Suite 325  
Columbus, Ohio 43212  
p 614.764.0407  
f 614.764.0237  
www.ma-architects.com

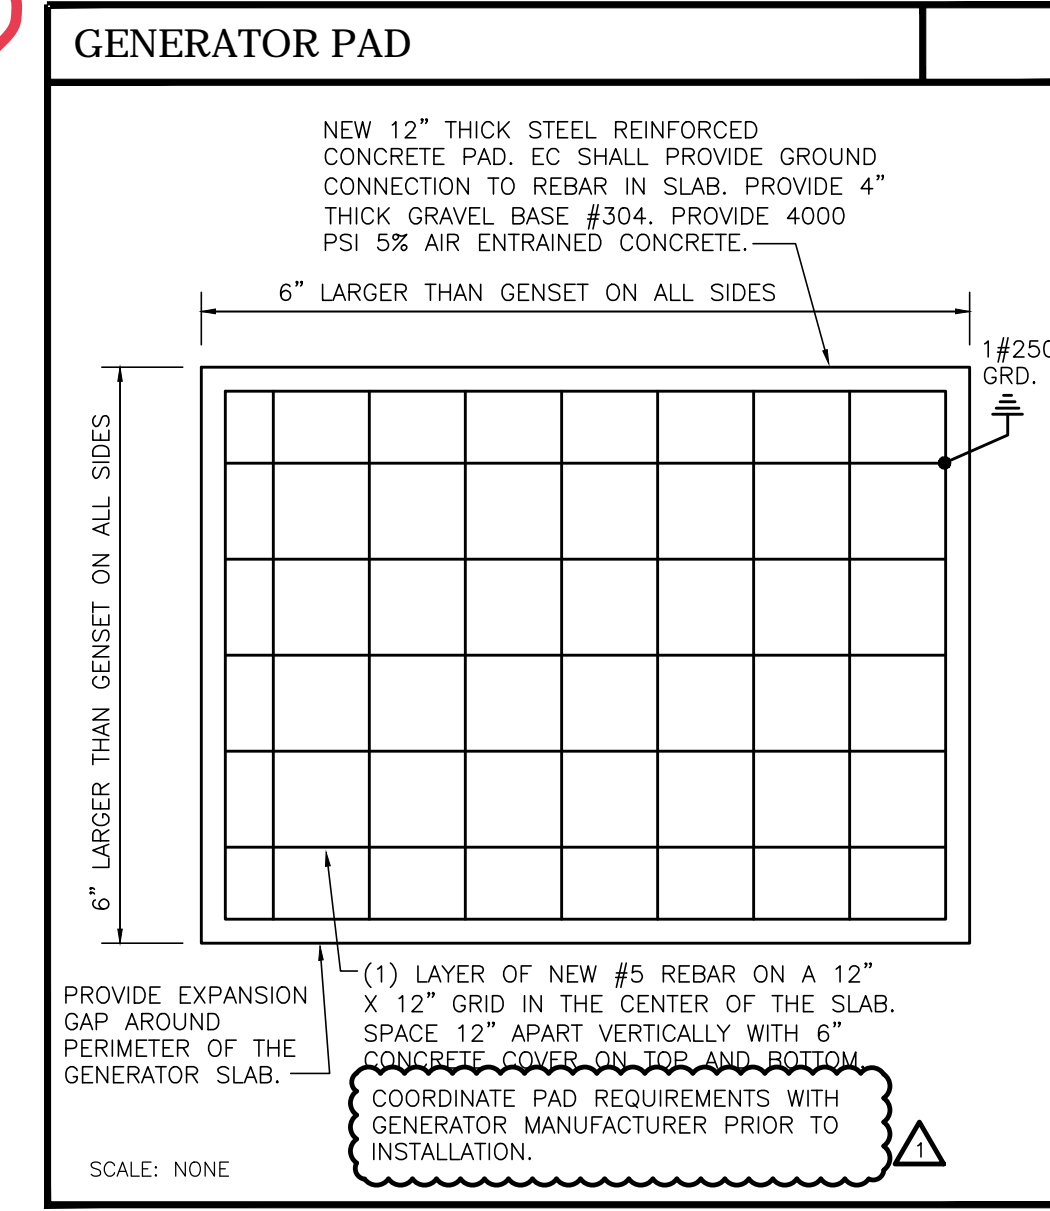

6225 Emerald Pkwy  
Dublin, Ohio 43016  
Phone: (614) 498-3862  
Fax: (614) 498-3909

**SAND HILL MEMORY CARE**

7775 JAMES MADISON HWY | GAINESVILLE, VA 20155 |

STATUS:



**REVISION:**

NO.	DATE	DESCRIPTION
1	27 MARCH 2019	ADDENDUM 1

**PROJECT NUMBER:**  
2018.250

**DRAWN BY:**  
VMP

**DATE:**  
11 FEB 2019

**SHEET NAME:**  
SITE UTILITY PLAN

**SHEET NUMBER:**

**SU.1**

ma architects